



# FILTER SETS D150 Compact

## DESCRIPTION

Vasco recommends cleaning the filters in your ventilation unit 3-monthly and 6-monthly replacement. Cleaning can be done with a vacuum cleaner. Replacement is easily indicated by the dirt filter message on the integrated display or optional wired control element, after the filter replacement time interval has elapsed:

- Dirt filter message on the integrated display:



- Dirt filter message on the optional wired control element:





Replace the filters (supply and return air) with official filter sets for Vasco ventilation units type D. Available from wholesalers or the Vasco "Accessory Shop". Then reset the dirt filter message on the integrated display or optional wired control element:

- Reset the dirt filter message on the integrated display via the main menu:



- Reset the dirt filter message on the optional wired control element via "User settings":

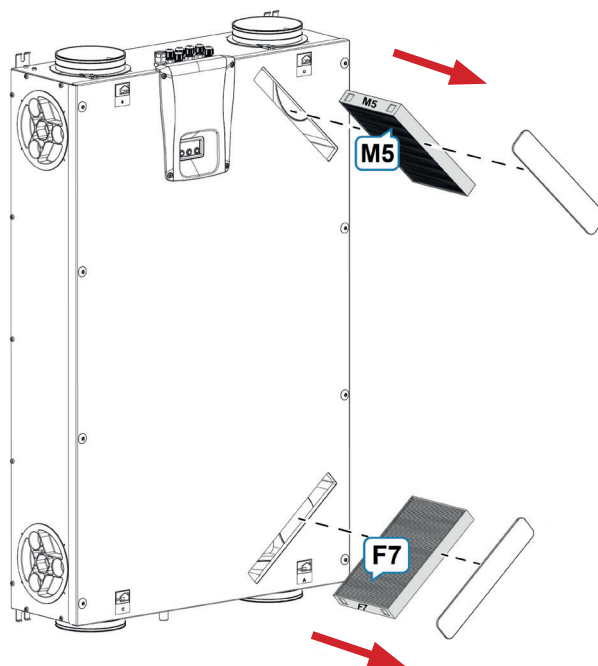

## TECHNICAL FEATURES

On ventilation units of type D150 Compact, the filters are accessible from the front of the unit. 2 separate filter caps need to be opened to gain access to the supply and return filters respectively.

Type ventilation unit	Dimensions [lxwxh mm]	Filter classification EN779 - ISO16890	Material	Image filter set
D150 Compact	230x150x25	F7 - ISO ePM1 55% M5 - ISO ePM10 50%	Synthetic Filter frame made of cardboard	