



# Energy Plus Filter Sets

## Description

Vasco recommends that the filters of your ventilation unit be cleaned every 3 months and replaced every 6 months. They can be cleaned with a vacuum cleaner. The wired wall-mounted control unit will simply display a maintenance message when the filters need to be replaced:

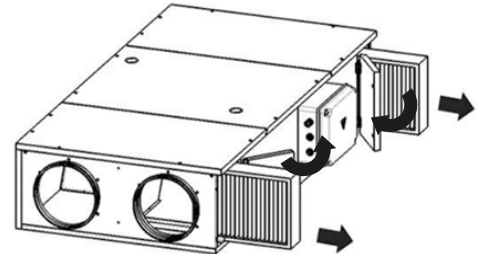

Replace the filters (supply and discharge air) with the official Vasco filter sets, which can be purchased from wholesale businesses. There is no need to reset the dirty filter warning, given that the message is displayed and triggered by the reading of the differential pressure switches in the ventilation unit. The message can be reset faster by briefly switching off the wired wall-mounted control unit.



## Technical Features

On the Energy Plus type of ventilation units the filters can be accessed on the side of the unit. 2 separate filter covers need to be opened to respectively gain access to the supply and discharge filter.

Ventilation Unit Type	Dimensions [lxbxh mm]	Filter Classification EN779 - ISO16890	Material	Filter Set Image
Energy Plus ENY-P1	405x285x98	F7 - ISO ePM1 55%	Frame: galvanised steel  Filter: micro glass fibre	
Energy Plus ENY-P2	555x326x98			
Energy Plus ENY-P3	595x408x98			
Energy Plus ENY-P4	830x547x98			